
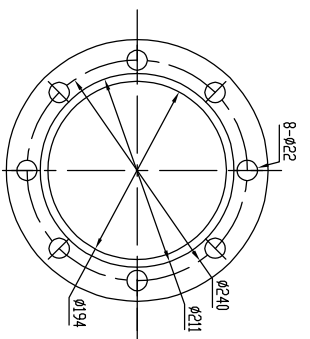


F130S-J03-03-03

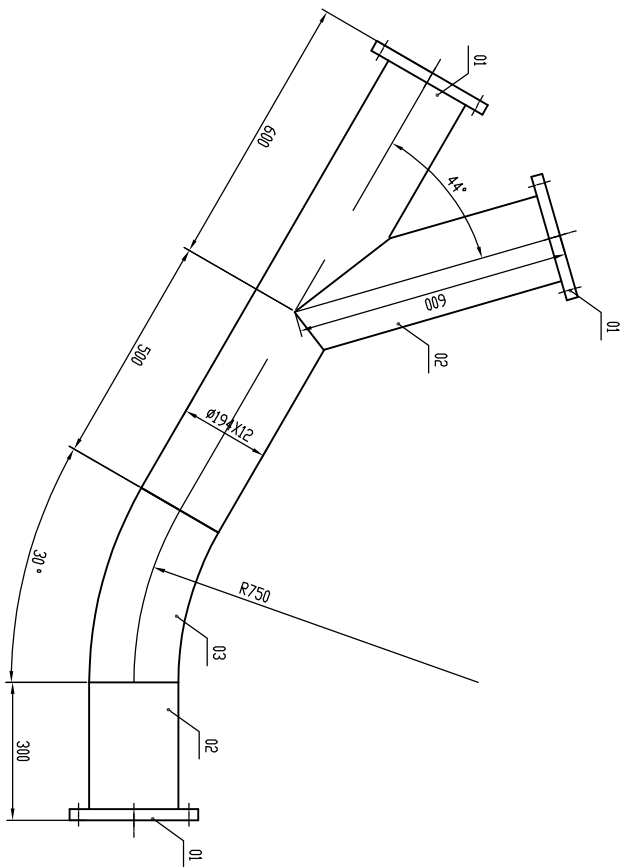


part 01 attached figure
1:5

total weight :15004Kg

03		Wear resistant bend pipeφ194x12-45° 1	assembly parts	20.4	20.4	
02		Wear resistant composite pipeφ194x12 2m	assembly parts	55.64	111.28	
01		non-standard flange	3 0235-A	6.12	18.36	
N.D.	Type	Name	Amount	Material	single weight	total weight

Technique requirements
1\It's non-standard flange, process according to the diagram;
2\Flange point weld, and other welds are to be steady and reliable,welding height is 6mm,and should keep the surface smooth;
3\Each boiler needs 2 such equipments.

 浙江华统环保系统工程有限公司 Zhejiang Huatong Environmental Protection System Engineering Co., Ltd		总工程师 项目负责人 Project Manager 设计负责人 Designer Manager	专 工 设 计 校 核 Check	日期 Date	比例 Scale	图 号 Drawing Code
					1:10	F130S-J03-03-03
		越南沿海一期火力发电厂项目气力输送系统 施工图设计阶段 DUYEN HAI 1 Thermal Power Plant Project Pneumatic ash handling system Design Stage				