

PT6

**Pri. Neutral should be solidly
Earthed Before Commissioning**

1a-1n, 110V/RT3, 50VA, CL:0.5
2a-2n, 110V/RT3, 50VA, CL:3P

KALPA 6.3KV VOLTAGE TRANSFORMER
RATIO: 6.3KV/RT3/110V/RT3 - 110V/RT3
BURDEN: 50/50VA CLASS: 0.5/3P
VOLTAGE FACTOR: 1.2 Cont / 1.9 For 30 Sec
ILV: 7.2/20/60KVp
SERIAL.NO/YEAR: 168221/12
1 PHASE
REF STD IEC: 60044-2 FREQ: 50/60Hz
MED: KALPA ELEKTRIKAL PVT.LTD., BANGALORE - 10, INDIA



SIN - VTS
PZEP100

32081-04
PT-6

110V/RT3

110V/RT3

1a


1n

2a

2n

N


KALPA

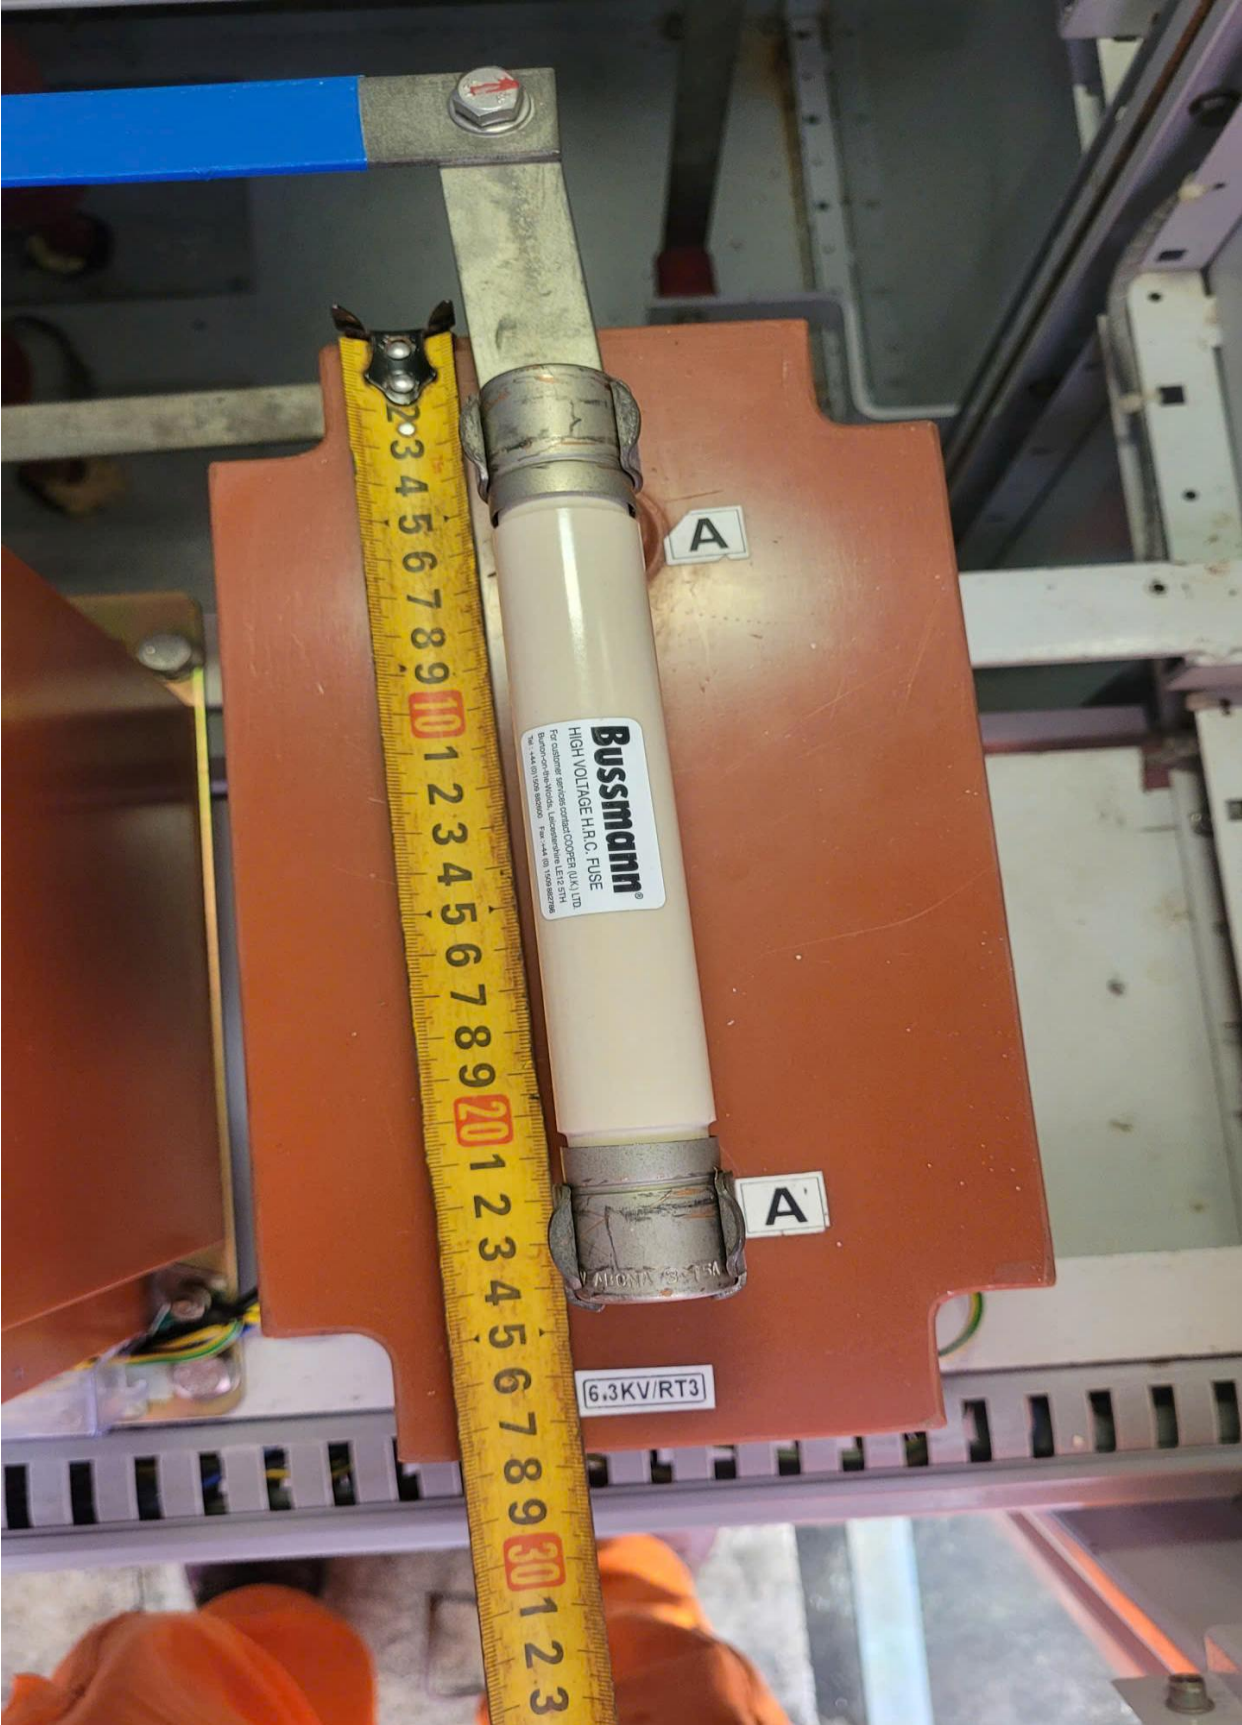







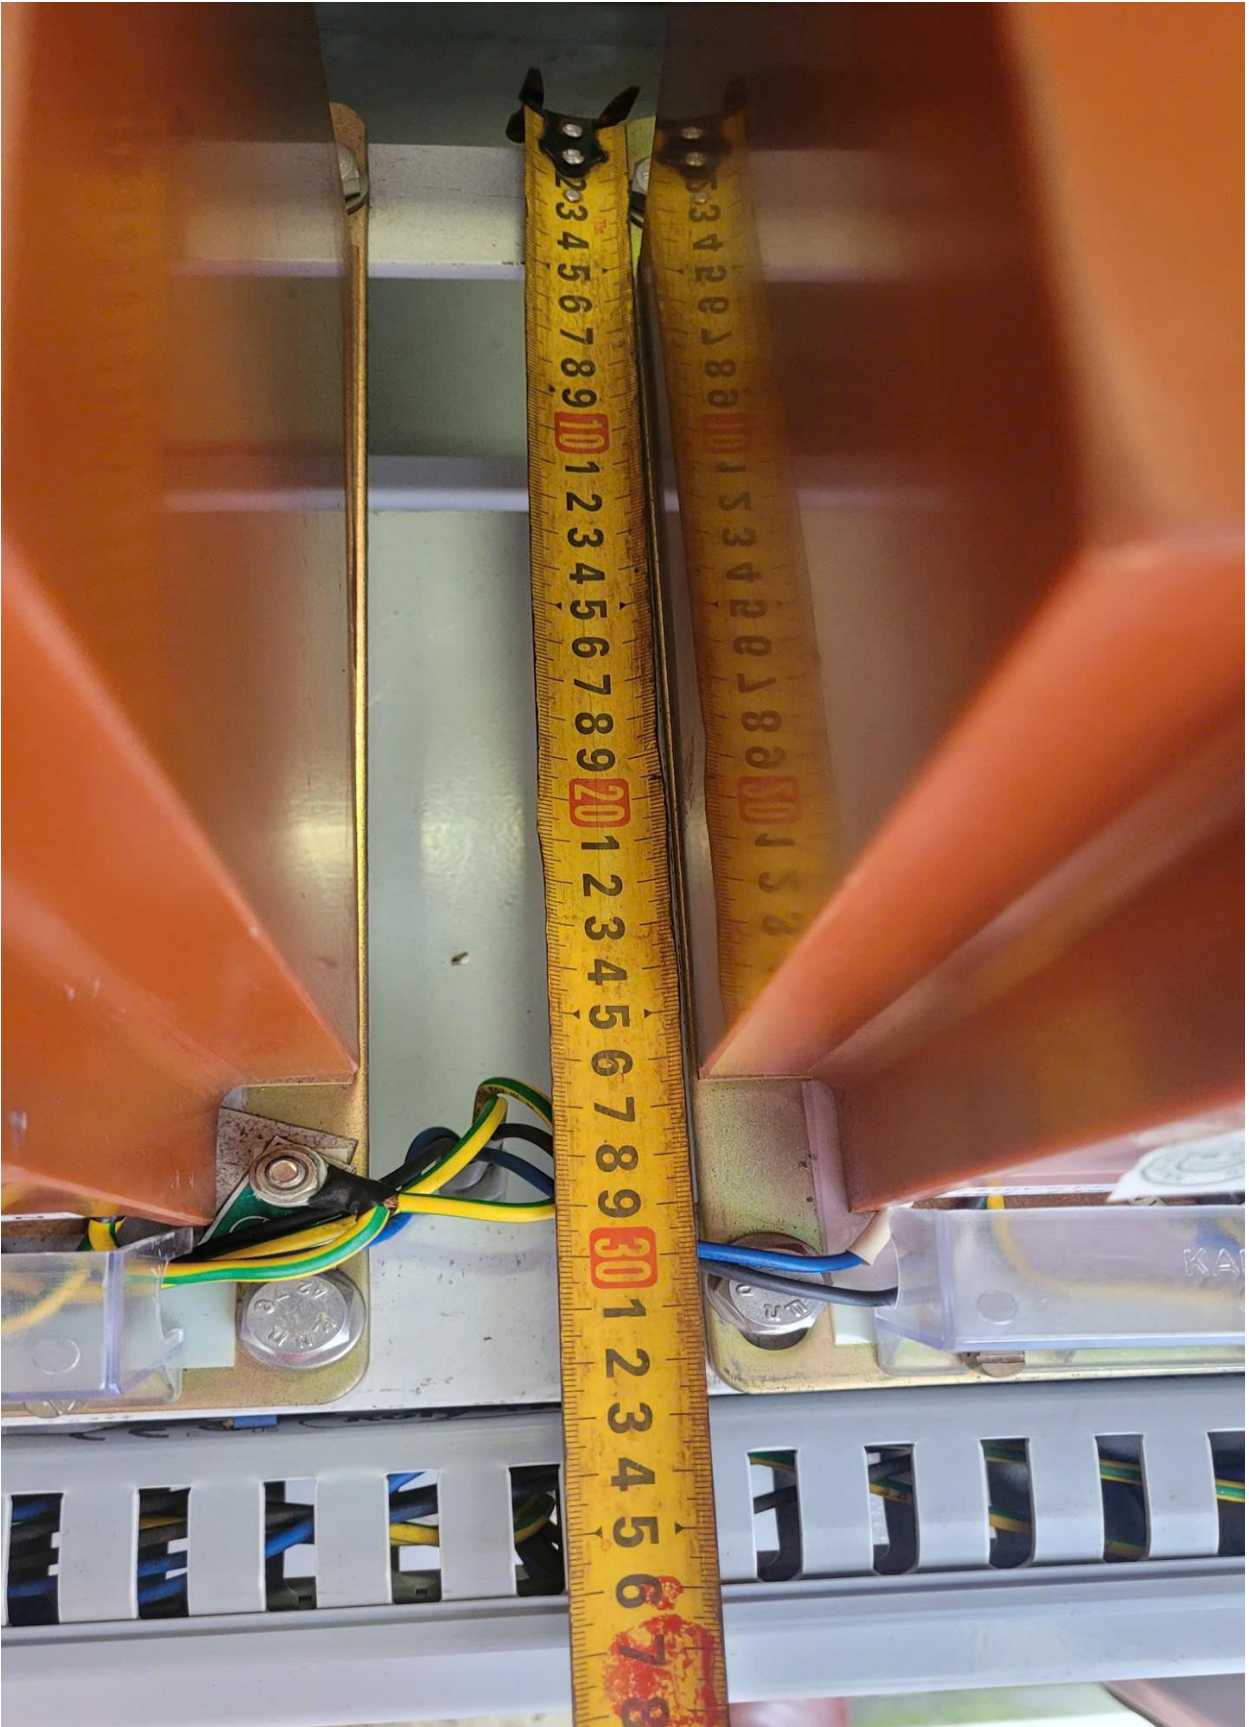



Pri. Neutral should be solidly Earthed Before Commissioning

1a-1n, 110V/RT3, 50VA, CL:0.5
2a-2n, 110V/RT3, 50VA, CL:3P

KALPA 6.3KV VOLTAGE TRANSFORMER
RATIO: 6.3KV/RT3/110V/RT3 - 110V/RT3
BURDEN: 50/50VA CLASS: 0.5
VOLTAGE FACTOR: 1.2 Cont / 1.9 For 30 Sec
ILV: 7.2/20/60KVp
SERIAL NO/YEAR: 168221/11
1 PHASE
REF STD IEC: 60044-2 FREQ: 50/60Hz
MED: KALPA ELEKTRIKAL PVT.LTD., BANGALORE - 10, II



110V/RT3
JUL 18/04
PT-6

110V/RT3
1a 1n 2a 2n
KALPA